


1. ALL HYDRANTS TO BE MANUFACTURED TO CITY OF WEST PALM BEACH SPECIFICATIONS, INCLUDING IRON WEATHER CAP, PER W.P.B. APPROVED PRODUCTS LIST.
2. BONNET SHALL BE PAINTED WITH REFLECTIVE COATING. ALL OTHER PARTS ABOVE BREAKWAY FLANGE SHALL BE PAINTED SILVER. ANY OTHER PARTS BELOW BREAKWAY FLANGE SHALL BE PAINTED BLACK. ALL PAINT MATERIALS TO BE AS SPECIFIED ON APPROVED MATERIALS LIST.
3. FOR PROJECTS WITHIN F.D.O.T. & PALM BEACH COUNTY R/W: HYDRANTS TO BE LOCATED IN DEDICATED EASEMENTS OUTSIDE OF R/W.
4. ALL JOINTS INCLUDING BELL AND SPIGOT SHALL BE RESTRAINED.
5. SEE "VALVE BOX SETTING" STANDARD FOR ADDITIONAL DETAILS.
6. IF DISTANCE BETWEEN FIRE HYDRANT AND ANCHOR TEE EXCEEDS 30 FT., ADD A SECOND VALVE 4 FT. FROM HYDRANT.
7. INSTALL A F.D.O.T. APPROVED BLUE R.P.M.(REFLECTIVE PAVEMENT MARKER) IN THE CENTER OF THE TRAVELING LANE, DIRECTLY IN FRONT OF HYDRANT.

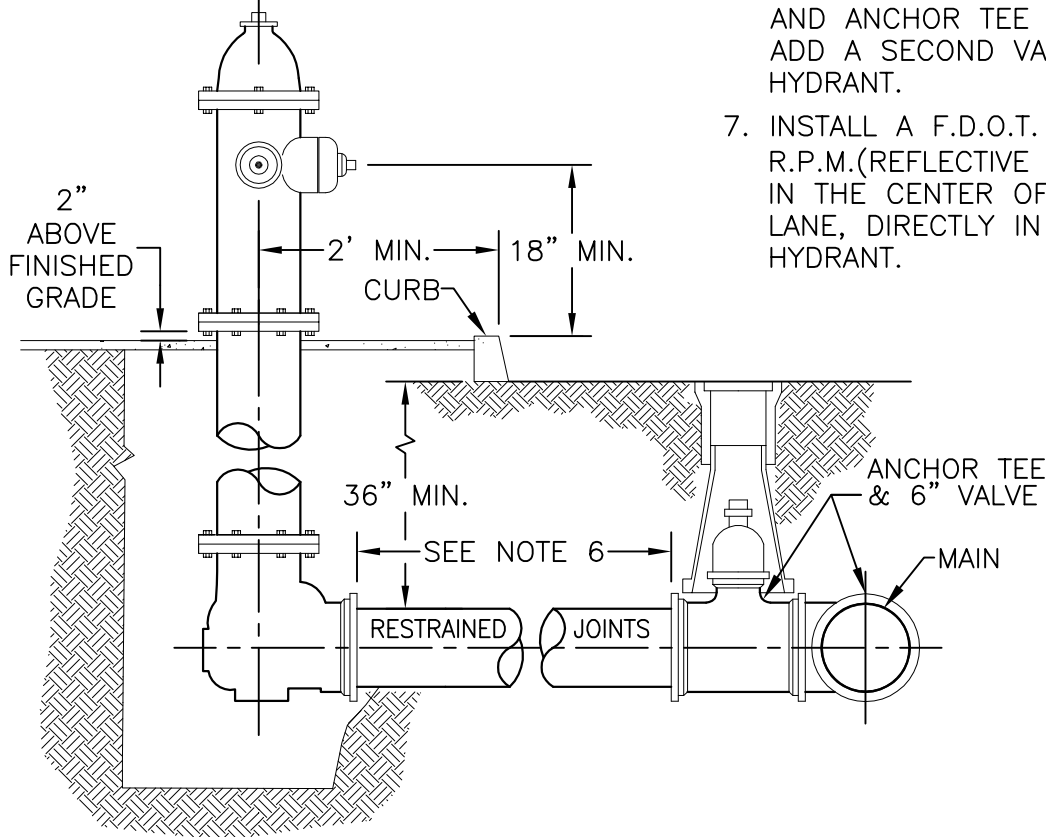

REVISED: SEPT-2009	PRESSURE PIPE - FIRE HYDRANT CONNECTION	STANDARD DETAIL
ISSUED: SEPT - 2009	CITY OF WEST PALM BEACH ENGINEERING SERVICES DEPT.	P-8